




WORK TO BE COMPLETED BY CONTRACTOR



WORK TO BE COMPLETED BY PROPERTY OWNER

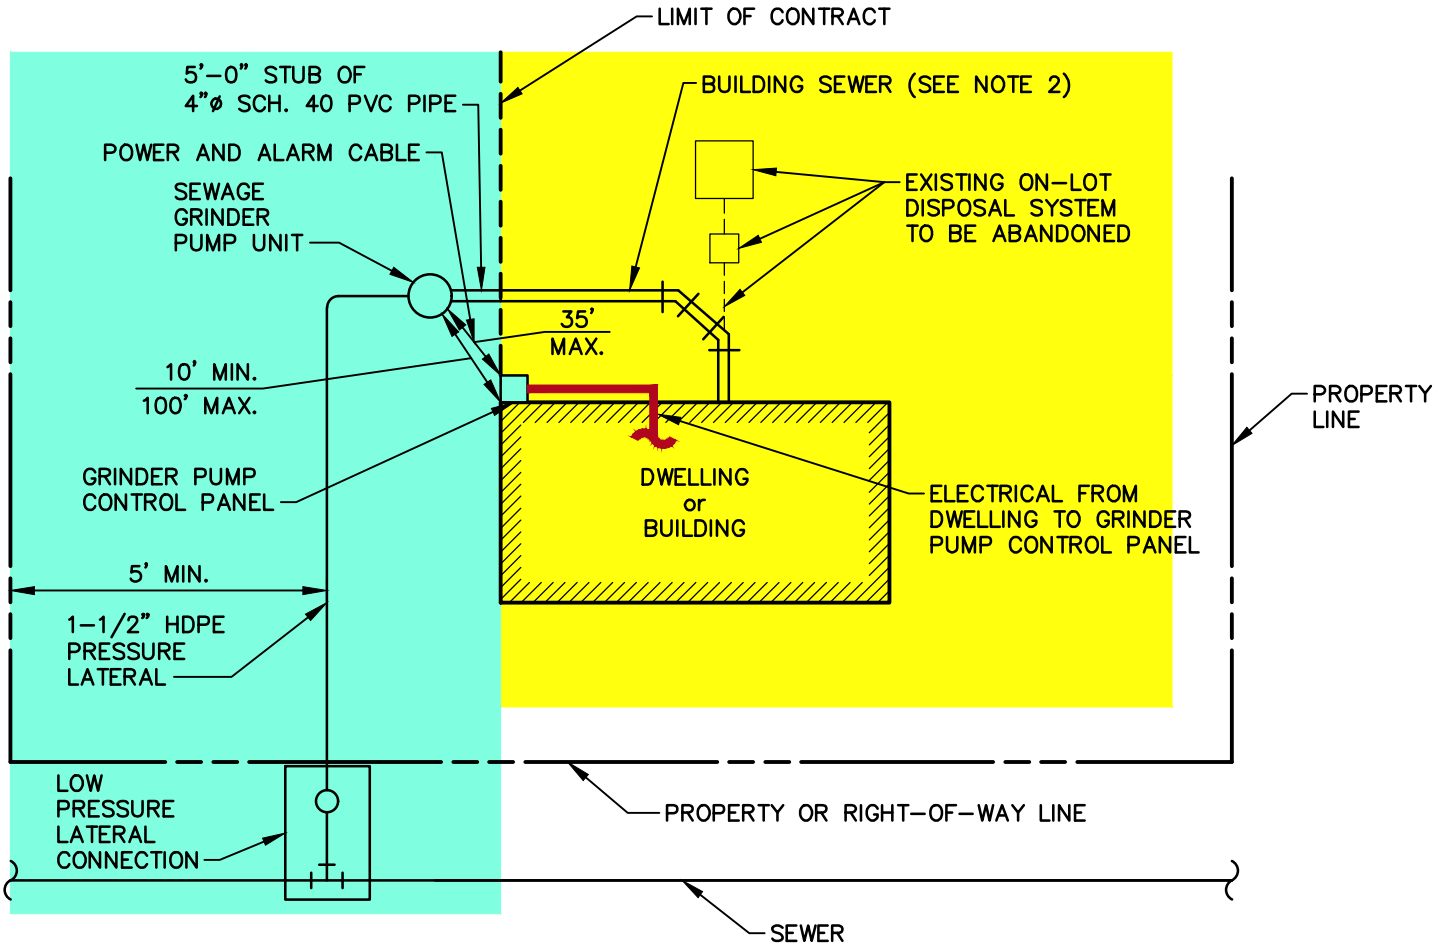

PLAN

NOTES:

1. GRINDER PUMP MUST BE LOCATED A MINIMUM OF 10 FT. FROM STRUCTURE.
2. BUILDING SEWER SHALL BE CONSTRUCTED IN ACCORDANCE WITH DEP GUIDELINES, AUTHORITY RULES AND REGS., AND INTERNATIONAL PLUMBING CODES.
3. CONTRACTOR TO COORDINATE LOCATION OF GRINDER PUMP UNIT AND CONTROL PANEL WITH PROPERTY OWNER.
4. DISTANCE BETWEEN DWELLING AND PRESSURE LATERAL SHALL BE 5' MINIMUM, OR AS REQUIRED BY LOCAL CODES, ORDINANCES, RULES AND REGULATIONS OF GOVERNING SERVICE AUTHORITY.



GRINDER PUMP INSTALLATION SCHEMATIC

NOT TO SCALE